


Legend

- Small Public Water Wells
- Assn. Member Wells
- △ ○ Less than 500 mg/L
- ▲ ● 500 to 1000 mg/L
- ▲ ● Greater than 1000 mg/L

• Small Public Water Supply System Wells regulated by the County of Stanislaus. Location is accurate only to the nearest section.

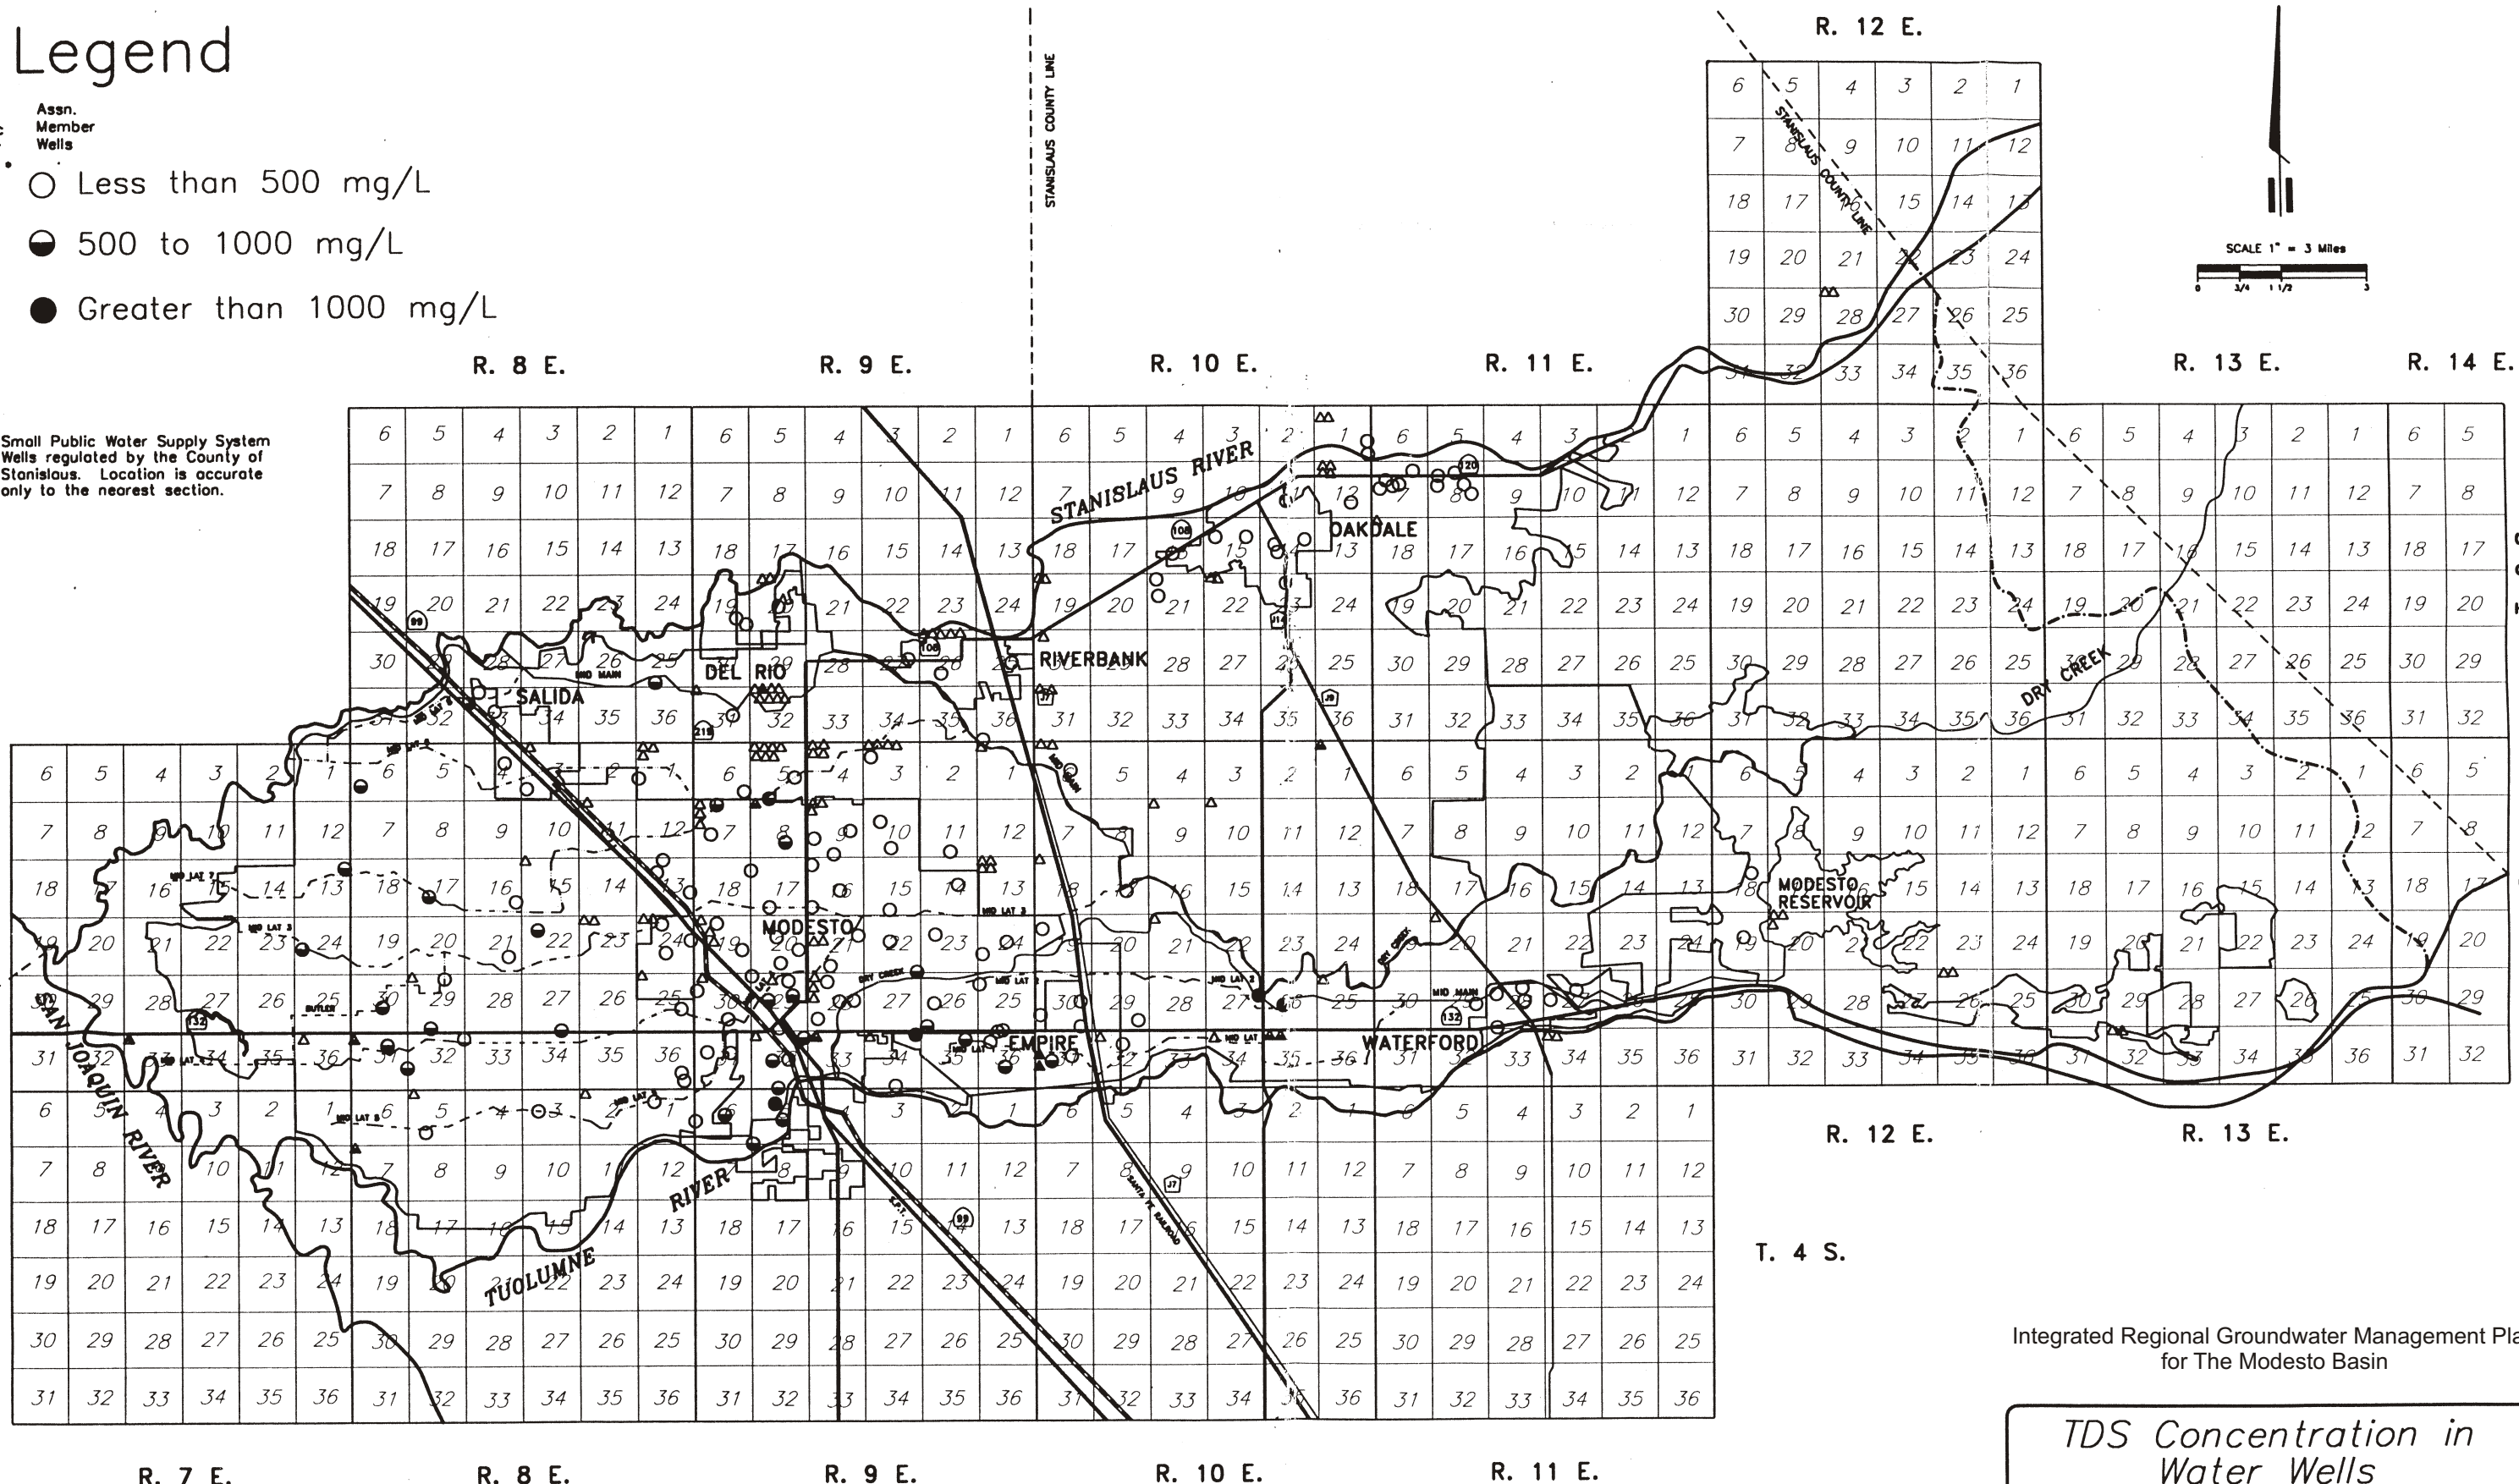

Integrated Regional Groundwater Management Plan
for The Modesto Basin

*TDS Concentration in
Water Wells*

Figure 4-14