


# Legend

- Small Public Water Wells
- △ ○ Less than 50% MCL (MCL = 45 mg/L)
  - ▲ ● 50% MCL to MCL
  - ▲ ● Greater than or Equal to MCL
  - Closed Wells

• Small Public Water Supply System Wells regulated by the County of Stanislaus. Location is accurate only to the nearest section.

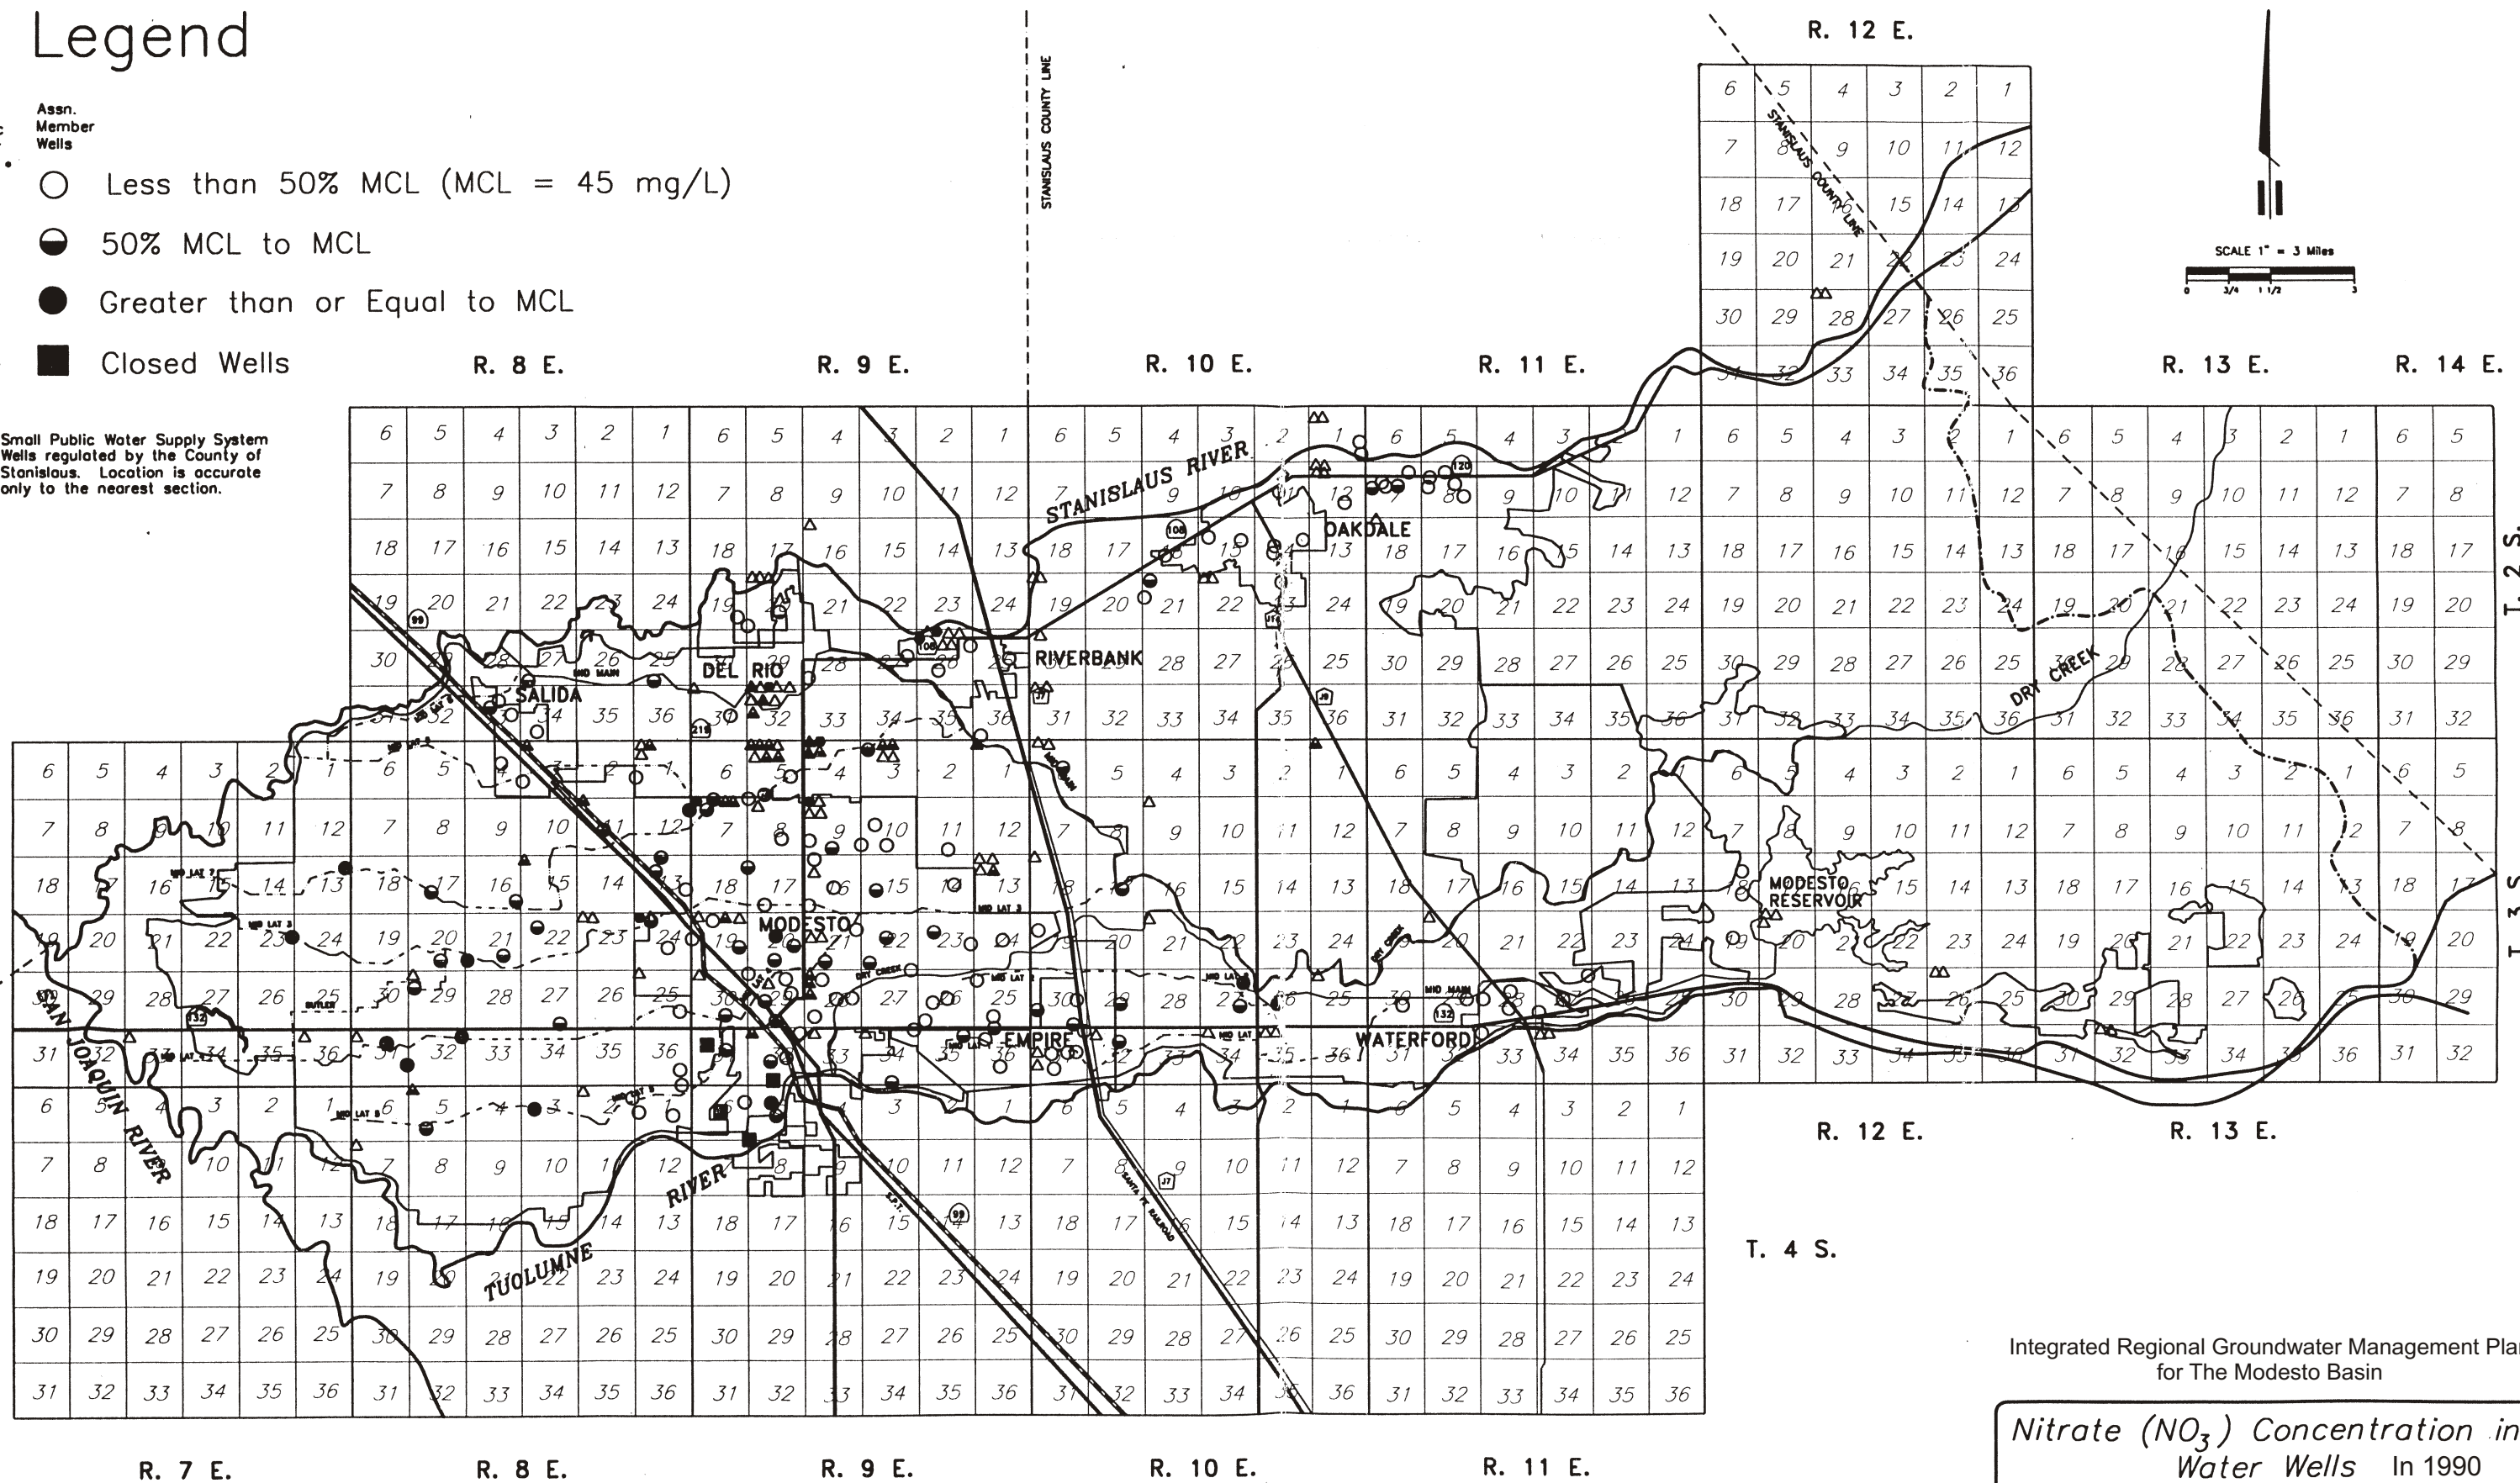

Integrated Regional Groundwater Management Plan  
for The Modesto Basin

Nitrate (NO<sub>3</sub>) Concentration in  
Water Wells In 1990

Figure 4-19