


# Legend

- |                          |                    |
|--------------------------|--------------------|
| Small Public Water Wells | Assn. Member Wells |
|--------------------------|--------------------|
- |   |   |                                 |
|---|---|---------------------------------|
| △ | ○ | Non-Detectable (ND ≤ 0.01 ug/L) |
| ▲ | ◐ | 0.01 to MCL (MCL = 0.2 ug/L)    |
| ● | ● | Greater than or Equal to MCL    |
| ▼ | ◆ | Wells with Wellhead Treatment   |
| ⬛ | ■ | Wells Closed Because of DBCP    |
- Small Public Water Supply System Wells regulated by the County of Stanislaus. Location is accurate only to the nearest section.

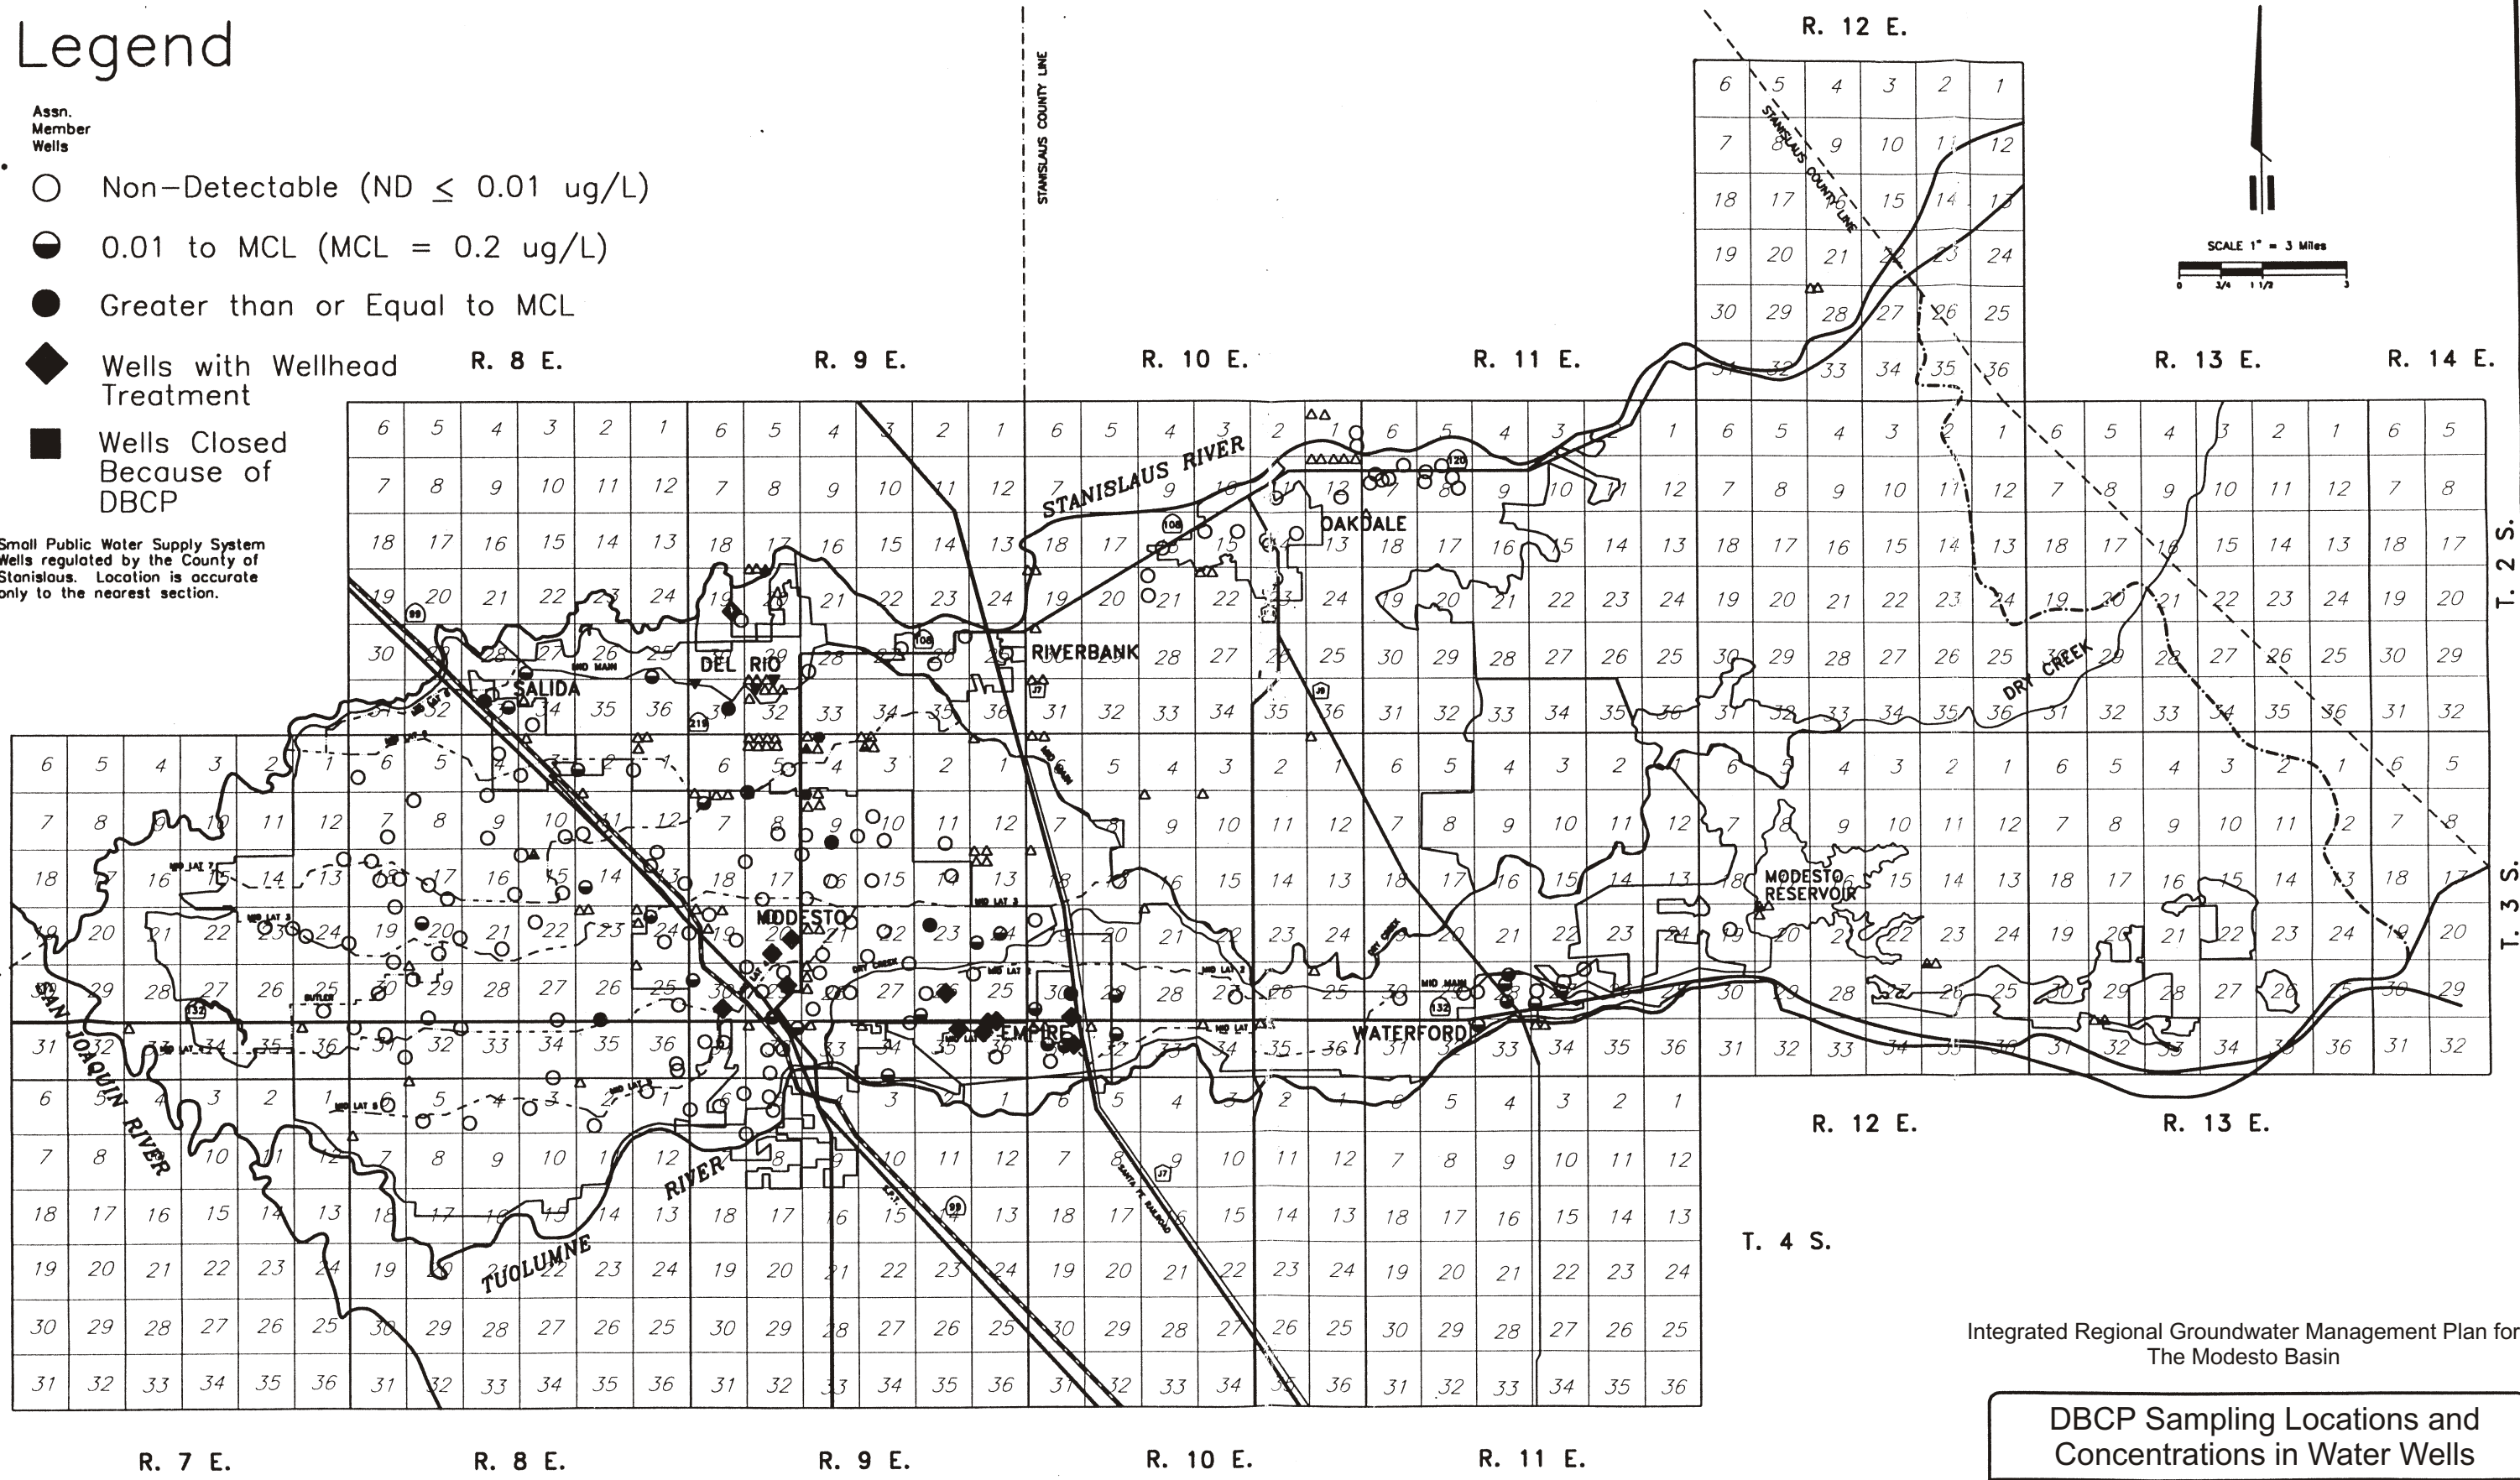

Integrated Regional Groundwater Management Plan for The Modesto Basin

DBCP Sampling Locations and Concentrations in Water Wells

FIGURE 4-21